



WES-150  
SJS-150  
HEALTH MINDER SJS-150  
WATERFREE SEALANT

## Material Safety Data Sheet

Page 1 of 2

### Section 1. PRODUCT AND COMPANY IDENTIFICATION

**PRODUCT:** SLOAN JANSAN WATERFREE SEALANT SJS-150  
Product Code: 0700015

**COMPANY:** Sloan Jan/San Div., Sloan Valve Co.      Emergency Tel: (800) 424-9300  
10500 Seymour Ave.      Telephone: (877) 652-6726  
Franklin Park, Illinois 60131-1259      Fax: (800) 447-8329

**PRODUCT TYPE OR USE:** Protectant-Sealant for Waterless Urinal Systems

### Section 2. EMERGENCY OVERVIEW

**Appearance:** A dark blue, free-flowing liquid with a mild odor of lemon/citronella.

**Possible Health Effects:** May cause irritation or tearing to eyes. May cause dryness or irritation of skin by prolonged contact. Harmful if swallowed.

### Section 3. HAZARDOUS INGREDIENTS / INFORMATION ON COMPOSITION

	CHEMICAL	CAS #	PERCENT RANGE	TLV	OSHA
Chemical Identity:	Proprietary	NA	90 - 95	NA	NA
	Fragrance mixture	NA	NA	NA	NA

### Section 4. POTENTIAL HEALTH EFFECTS

**HMIS:** Health 1 Flammability 1 Reactivity 0 Personal Protection B (Safety glasses, gloves)

**Eye Contact:** Causes eye irritation on contact.  
**Skin Contact:** May cause skin irritation or dryness upon prolonged or repeated contact.  
**Inhalation:** Breathing mist or spray may cause dryness or irritation of the nose.  
**Ingestion:** May cause upset stomach, vomiting, nausea or diarrhea.  
**Carcinogenicity:** Ingredients not listed by NTP, OSHA, or IRAC.

### Section 5. FIRST AID MEASURES

**Eye Contact:** Immediately flush eyes with a large volume of water while removing contact lenses if present. Get medical attention if burning or irritation persist.  
**Skin Contact:** Remove contaminated clothing. Wash with water. If irritation develops, get medical attention.  
**Ingestion:** Harmful if swallowed. Do not induce vomiting. Give large amounts of water. Contact a Poison Center or Physician immediately.  
**Inhalation:** Move to fresh air. If breathing difficulty continues, get medical help.

### Section 6. FIRE FIGHTING MEASURES

**NFPA:** Health 1 Fire 1 Reactivity 0  
**Flash Point:** None (Method) NA      **Lower Explosion Limit:** NA      **Upper Explosion Limit:** NA  
**Autoignition Temperature:** Not determined  
**Extinguishing Media:** Water spray, carbon dioxide, dry chemical.  
**Special Fire Fighting Procedures:** Standard fire fighting procedures may be followed, including wear of full protective gear and NJOSH self-contained breathing apparatus in fire area.  
**Unusual Fire and Explosive Hazards:** None known. Do not store or use around open flames.  
**Products of Combustion in Fire:** Forms oxides of carbon during combustion.

### Section 7. ACCIDENTAL RELEASE MEASURES

Contain spill. Mop up and clean surface with water. Discharge small amounts of diluted chemicals to a sanitary sewer. Caution, spilled product will cause slippery surface. Avoid falls, clean up spills immediately. Spills of this product do not need to be reported to the National Response Center.

### Section 8. STORAGE AND HANDLING

Store in original package at room temperature. Store and use away from open flames or sparks. Keep Out Of Reach Of Children. If liquid contact skin while installing refill unit into fixture, wash skin and hands with water.  
**Other Precautions:** Use only in accordance with label directions. If unsure of proper installation in waterless urinal, contact your supervisor. Do not mix with strong acids.

**SLOAN JANSAN**  
A Division of Sloan Valve Company  
10500 Seymour Avenue  
Franklin Park, IL 60131-1259  
Phone: 877-6-JANSAN (877-652-6726)  
Fax: 800-447-8329  
[www.sloanjansan.com](http://www.sloanjansan.com)

The information contained in this document is subject to change without notice.

©2006 Sloan Valve Company  
Sloan JANSAN  
A Division of Sloan Valve Company  
Printed In the U.S.A. JSD6070 9/06

# SLOAN


# WES-150

## WATERFREE URINAL CARTRIDGE KIT

The WES-150 Sloan Waterfree Urinal Cartridge is the main component and is installed at the base of the urinal.

The replaceable liquid-sealed cartridge filters waste so liquids enter the drain and sediments are collected for disposal when the cartridge is replaced after 6,000 to 7,000 uses. Waste passes through a layer of Sealant, continues through a trap and flows around a Patented Baffle to prevent the loss of Sealant. A Discharge Tube in the housing directs the flow of waste into the building drain system. The Cartridge is designed as a replaceable component once depleted.

WES-150

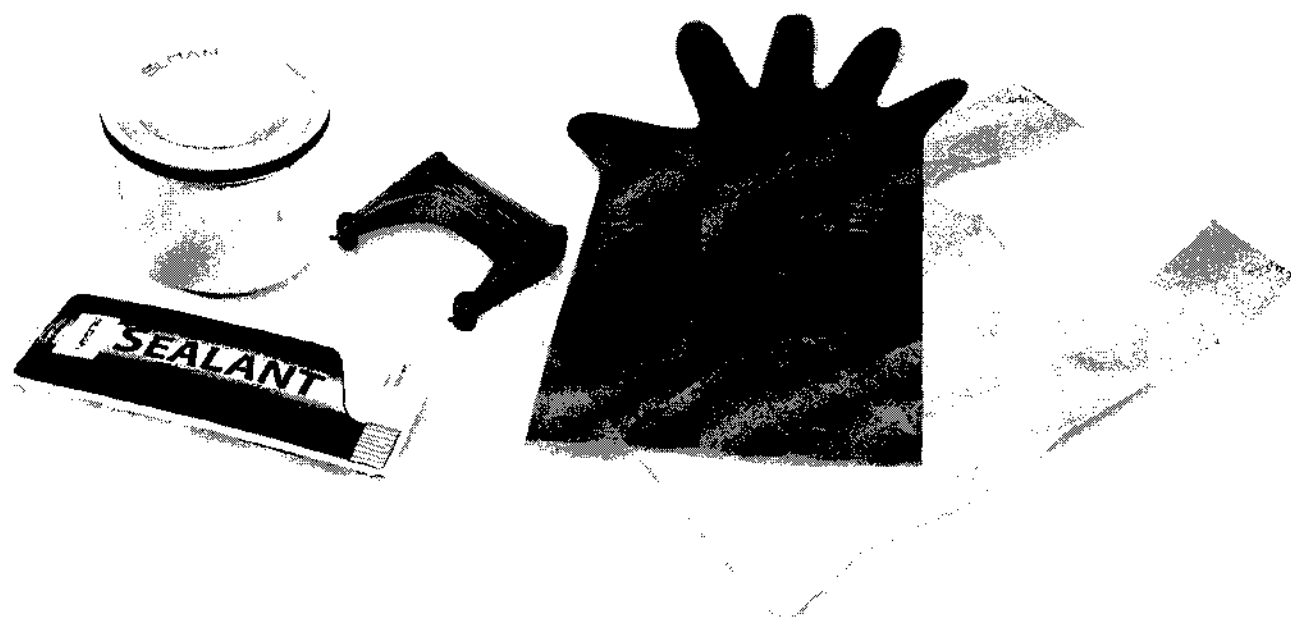

### Kit includes:

- Cartridge made from recyclable ABS
- Sealant Liquid — 100% biodegradable
- Cartridge Installation/Removal Tool
- Protective Glove
- Disposal Bag

**Product Number:** WES-150

**Product Code:** 1001500

**Color:** White

**Quantity/pack:** 1

**Quantity/case:** 32

### Refills:

Cartridge

- Uses no water
- Patented, Sealed Locking Cartridge
- Biodegradable Cartridge Sealant Liquid eliminates all odors
- Improves hygiene
- Easy installation and replacement

The information contained in this document is subject to change without notice.

## SLOAN.

Sloan HEALTHMINDER™ Products and Service  
10500 Seymour Avenue  
Franklin Park, IL 60131-1259  
Phone: 877-652-6726  
Fax: 800-447-8329  
[www.sloanvalve.com](http://www.sloanvalve.com)

©2008 Sloan Valve Company  
Printed in the U.S.A. JSD6017.2 1/08

*wgt 1.30 lbs ea*